

BT Telephone Master Grid Outlet

Standards, Approvals & Directives

Conforms to BS 6312 Part 2 (Connectors for Analogue Telecoms).

BS EN 41003 (Safety Requirements for Telecom Networks).

Description


The Telecom PSTN Master has been designed for domestic installations and acts as a the demarcation point between the customer and the service provider.

Similar to an RJ11 connector, but feature a side-mounted hook, rather than a bottom-mounted one and are physically incompatible.

Installation

Wire Preparation:

Carefully strip 50mm of the cable outer sheath to expose the inner conductors.




Connection:

Using a suitable IDC tool, push each wire into the correct IDC as per wiring guide.

Wiring Scheme:

2 - BLUE/White
3 - ORANGE/White
5 - WHITE/Blue




Features

- Suitable for direct connection to the Public Service Telephone Network.
- Fitted with bell capacitor, resistor and voltage surge protection.
- IDC labelling individually numbered

Recommended Box Depth:

25 mm

Metal boxes to BS4662.

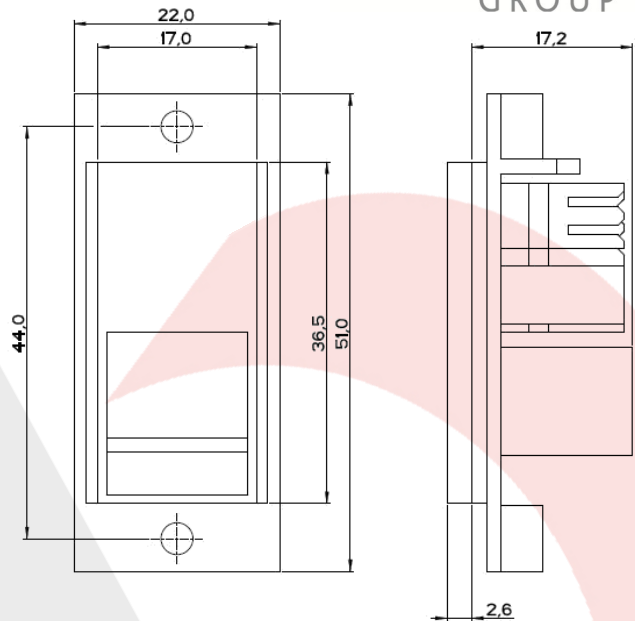

Availability

All of our data, media and USB charger outlets can be used with all of our ranges of wiring accessory plates and can be specified to contain single or multiple outlets depending upon requirement.

Single or multiple outlets are supplied in either Black or White polycarbonate housings to complement the finish of the chosen plate.

Ordering

All modular interiors fit into our switch plates and grids, making them available across all of our ranges. However, when ordering in the Series 3 range, the following grids must be used for installation.

G981/* - 1 Gang

G982/* - 2 Gang

G983/* - 3 Gang

G984/* - 4 Gang

When ordering please state the catalogue number of the required module.

Catalogue Numbers:

* Finishes available:

3706011 = White

3706012 = Black

Tel: +44(0)1483 713 400

Email: sales@wandsworthgroup.com